

N7007012 - Recent revisions

Rev.	Comment	Date	Drawn	Appr.
2.0	Gas Network	09/10/23	JM	JP
1.1	Legacy: 473m of 25mm LP PE80	09/08/20	DN	DN
1.0	Legacy: 1157m of 25mm LP PE80	13/12/16	CH	CH

Gas Note:
 All gas mains and ducts that contain a gas main must be overlaid with a yellow line. All gas mains and ducts that do not contain a gas main must be overlaid with a red line. All gas mains and ducts that do not contain a gas main must be overlaid with a red line. All gas mains and ducts that do not contain a gas main must be overlaid with a red line.

Maximum Proximity to Properties

Maximum Building Proximity (m)	1.5 bar	2 bar	2.5 bar	3 bar
Up to 125	2	4	4	6
125 to 250	2	4	4	6
250 to 500	1	2	4	8
500 to 1000	1	5	13	15

Ducting Specification

- Ducting for mains must be yellow and non-perforated and only used perpendicular to the main.
- Ducting for services must be yellow and perforated along its entire length.
- Only one pipe is allowed per duct.

Gas Pipe External Diameter	Duct Inside Diameter
25mm & 32mm	40mm
40mm	100mm
50mm	150mm
75mm	200mm
100mm	300mm
150mm & 200mm	400mm

Marker Positions

- For all marker types any position where damage could occur, especially from vehicles, shall be avoided.
- Some concealed (vertical) meter boxes shall not:
- Be a trip hazard
- Be a fire hazard

Excavation Carried Out by BUUK
 All excavations shall be excavated and reinstated by the contractor. The reinstatement shall be to the satisfaction of the other interested parties. It will be the responsibility of the customer.

Plan Notes

- Proposed
- Lead
- 100mm MP PE80
- 25mm LP PE80
- 50mm LP PE80
- 75mm LP PE80
- 100mm LP PE80
- 150mm LP PE80
- 200mm LP PE80
- 250mm LP PE80
- 300mm LP PE80
- 400mm LP PE80
- 500mm LP PE80
- 600mm LP PE80
- 700mm LP PE80
- 800mm LP PE80
- 900mm LP PE80
- 1000mm LP PE80
- 1100mm LP PE80
- 1200mm LP PE80
- 1300mm LP PE80
- 1400mm LP PE80
- 1500mm LP PE80
- 1600mm LP PE80
- 1700mm LP PE80
- 1800mm LP PE80
- 1900mm LP PE80
- 2000mm LP PE80
- 2100mm LP PE80
- 2200mm LP PE80
- 2300mm LP PE80
- 2400mm LP PE80
- 2500mm LP PE80
- 2600mm LP PE80
- 2700mm LP PE80
- 2800mm LP PE80
- 2900mm LP PE80
- 3000mm LP PE80
- 3100mm LP PE80
- 3200mm LP PE80
- 3300mm LP PE80
- 3400mm LP PE80
- 3500mm LP PE80
- 3600mm LP PE80
- 3700mm LP PE80
- 3800mm LP PE80
- 3900mm LP PE80
- 4000mm LP PE80
- 4100mm LP PE80
- 4200mm LP PE80
- 4300mm LP PE80
- 4400mm LP PE80
- 4500mm LP PE80
- 4600mm LP PE80
- 4700mm LP PE80
- 4800mm LP PE80
- 4900mm LP PE80
- 5000mm LP PE80
- 5100mm LP PE80
- 5200mm LP PE80
- 5300mm LP PE80
- 5400mm LP PE80
- 5500mm LP PE80
- 5600mm LP PE80
- 5700mm LP PE80
- 5800mm LP PE80
- 5900mm LP PE80
- 6000mm LP PE80
- 6100mm LP PE80
- 6200mm LP PE80
- 6300mm LP PE80
- 6400mm LP PE80
- 6500mm LP PE80
- 6600mm LP PE80
- 6700mm LP PE80
- 6800mm LP PE80
- 6900mm LP PE80
- 7000mm LP PE80
- 7100mm LP PE80
- 7200mm LP PE80
- 7300mm LP PE80
- 7400mm LP PE80
- 7500mm LP PE80
- 7600mm LP PE80
- 7700mm LP PE80
- 7800mm LP PE80
- 7900mm LP PE80
- 8000mm LP PE80
- 8100mm LP PE80
- 8200mm LP PE80
- 8300mm LP PE80
- 8400mm LP PE80
- 8500mm LP PE80
- 8600mm LP PE80
- 8700mm LP PE80
- 8800mm LP PE80
- 8900mm LP PE80
- 9000mm LP PE80
- 9100mm LP PE80
- 9200mm LP PE80
- 9300mm LP PE80
- 9400mm LP PE80
- 9500mm LP PE80
- 9600mm LP PE80
- 9700mm LP PE80
- 9800mm LP PE80
- 9900mm LP PE80
- 10000mm LP PE80

Excavation Carried Out by BUUK

Excavation shall be carried out by the contractor. The reinstatement shall be to the satisfaction of the other interested parties. It will be the responsibility of the customer.

Plan Notes

- Proposed
- Lead
- 100mm MP PE80
- 25mm LP PE80
- 50mm LP PE80
- 75mm LP PE80
- 100mm LP PE80
- 150mm LP PE80
- 200mm LP PE80
- 250mm LP PE80
- 300mm LP PE80
- 400mm LP PE80
- 500mm LP PE80
- 600mm LP PE80
- 700mm LP PE80
- 800mm LP PE80
- 900mm LP PE80
- 1000mm LP PE80
- 1100mm LP PE80
- 1200mm LP PE80
- 1300mm LP PE80
- 1400mm LP PE80
- 1500mm LP PE80
- 1600mm LP PE80
- 1700mm LP PE80
- 1800mm LP PE80
- 1900mm LP PE80
- 2000mm LP PE80
- 2100mm LP PE80
- 2200mm LP PE80
- 2300mm LP PE80
- 2400mm LP PE80
- 2500mm LP PE80
- 2600mm LP PE80
- 2700mm LP PE80
- 2800mm LP PE80
- 2900mm LP PE80
- 3000mm LP PE80
- 3100mm LP PE80
- 3200mm LP PE80
- 3300mm LP PE80
- 3400mm LP PE80
- 3500mm LP PE80
- 3600mm LP PE80
- 3700mm LP PE80
- 3800mm LP PE80
- 3900mm LP PE80
- 4000mm LP PE80
- 4100mm LP PE80
- 4200mm LP PE80
- 4300mm LP PE80
- 4400mm LP PE80
- 4500mm LP PE80
- 4600mm LP PE80
- 4700mm LP PE80
- 4800mm LP PE80
- 4900mm LP PE80
- 5000mm LP PE80
- 5100mm LP PE80
- 5200mm LP PE80
- 5300mm LP PE80
- 5400mm LP PE80
- 5500mm LP PE80
- 5600mm LP PE80
- 5700mm LP PE80
- 5800mm LP PE80
- 5900mm LP PE80
- 6000mm LP PE80
- 6100mm LP PE80
- 6200mm LP PE80
- 6300mm LP PE80
- 6400mm LP PE80
- 6500mm LP PE80
- 6600mm LP PE80
- 6700mm LP PE80
- 6800mm LP PE80
- 6900mm LP PE80
- 7000mm LP PE80
- 7100mm LP PE80
- 7200mm LP PE80
- 7300mm LP PE80
- 7400mm LP PE80
- 7500mm LP PE80
- 7600mm LP PE80
- 7700mm LP PE80
- 7800mm LP PE80
- 7900mm LP PE80
- 8000mm LP PE80
- 8100mm LP PE80
- 8200mm LP PE80
- 8300mm LP PE80
- 8400mm LP PE80
- 8500mm LP PE80
- 8600mm LP PE80
- 8700mm LP PE80
- 8800mm LP PE80
- 8900mm LP PE80
- 9000mm LP PE80
- 9100mm LP PE80
- 9200mm LP PE80
- 9300mm LP PE80
- 9400mm LP PE80
- 9500mm LP PE80
- 9600mm LP PE80
- 9700mm LP PE80
- 9800mm LP PE80
- 9900mm LP PE80
- 10000mm LP PE80

Excavation Carried Out by BUUK

Excavation shall be carried out by the contractor. The reinstatement shall be to the satisfaction of the other interested parties. It will be the responsibility of the customer.

Plan Notes

- Proposed
- Lead
- 100mm MP PE80
- 25mm LP PE80
- 50mm LP PE80
- 75mm LP PE80
- 100mm LP PE80
- 150mm LP PE80
- 200mm LP PE80
- 250mm LP PE80
- 300mm LP PE80
- 400mm LP PE80
- 500mm LP PE80
- 600mm LP PE80
- 700mm LP PE80
- 800mm LP PE80
- 900mm LP PE80
- 1000mm LP PE80
- 1100mm LP PE80
- 1200mm LP PE80
- 1300mm LP PE80
- 1400mm LP PE80
- 1500mm LP PE80
- 1600mm LP PE80
- 1700mm LP PE80
- 1800mm LP PE80
- 1900mm LP PE80
- 2000mm LP PE80
- 2100mm LP PE80
- 2200mm LP PE80
- 2300mm LP PE80
- 2400mm LP PE80
- 2500mm LP PE80
- 2600mm LP PE80
- 2700mm LP PE80
- 2800mm LP PE80
- 2900mm LP PE80
- 3000mm LP PE80
- 3100mm LP PE80
- 3200mm LP PE80
- 3300mm LP PE80
- 3400mm LP PE80
- 3500mm LP PE80
- 3600mm LP PE80
- 3700mm LP PE80
- 3800mm LP PE80
- 3900mm LP PE80
- 4000mm LP PE80
- 4100mm LP PE80
- 4200mm LP PE80
- 4300mm LP PE80
- 4400mm LP PE80
- 4500mm LP PE80
- 4600mm LP PE80
- 4700mm LP PE80
- 4800mm LP PE80
- 4900mm LP PE80
- 5000mm LP PE80
- 5100mm LP PE80
- 5200mm LP PE80
- 5300mm LP PE80
- 5400mm LP PE80
- 5500mm LP PE80
- 5600mm LP PE80
- 5700mm LP PE80
- 5800mm LP PE80
- 5900mm LP PE80
- 6000mm LP PE80
- 6100mm LP PE80
- 6200mm LP PE80
- 6300mm LP PE80
- 6400mm LP PE80
- 6500mm LP PE80
- 6600mm LP PE80
- 6700mm LP PE80
- 6800mm LP PE80
- 6900mm LP PE80
- 7000mm LP PE80
- 7100mm LP PE80
- 7200mm LP PE80
- 7300mm LP PE80
- 7400mm LP PE80
- 7500mm LP PE80
- 7600mm LP PE80
- 7700mm LP PE80
- 7800mm LP PE80
- 7900mm LP PE80
- 8000mm LP PE80
- 8100mm LP PE80
- 8200mm LP PE80
- 8300mm LP PE80
- 8400mm LP PE80
- 8500mm LP PE80
- 8600mm LP PE80
- 8700mm LP PE80
- 8800mm LP PE80
- 8900mm LP PE80
- 9000mm LP PE80
- 9100mm LP PE80
- 9200mm LP PE80
- 9300mm LP PE80
- 9400mm LP PE80
- 9500mm LP PE80
- 9600mm LP PE80
- 9700mm LP PE80
- 9800mm LP PE80
- 9900mm LP PE80
- 10000mm LP PE80

Excavation Carried Out by BUUK

Excavation shall be carried out by the contractor. The reinstatement shall be to the satisfaction of the other interested parties. It will be the responsibility of the customer.

Plan Notes


- Proposed
- Lead
- 100mm MP PE80
- 25mm LP PE80
- 50mm LP PE80
- 75mm LP PE80
- 100mm LP PE80
- 150mm LP PE80
- 200mm LP PE80
- 250mm LP PE80
- 300mm LP PE80
- 400mm LP PE80
- 500mm LP PE80
- 600mm LP PE80
- 700mm LP PE80
- 800mm LP PE80
- 900mm LP PE80
- 1000mm LP PE80
- 1100mm LP PE80
- 1200mm LP PE80
- 1300mm LP PE80
- 1400mm LP PE80
- 1500mm LP PE80
- 1600mm LP PE80
- 1700mm LP PE80
- 1800mm LP PE80
- 1900mm LP PE80
- 2000mm LP PE80
- 2100mm LP PE80
- 2200mm LP PE80
- 2300mm LP PE80
- 2400mm LP PE80
- 2500mm LP PE80
- 2600mm LP PE80
- 2700mm LP PE80
- 2800mm LP PE80
- 2900mm LP PE80
- 3000mm LP PE80
- 3100mm LP PE80
- 3200mm LP PE80
- 3300mm LP PE80
- 3400mm LP PE80
- 3500mm LP PE80
- 3600mm LP PE80
- 3700mm LP PE80
- 3800mm LP PE80
- 3900mm LP PE80
- 4000mm LP PE80
- 4100mm LP PE80
- 4200mm LP PE80
- 4300mm LP PE80
- 4400mm LP PE80
- 4500mm LP PE80
- 4600mm LP PE80
- 4700mm LP PE80
- 4800mm LP PE80
- 4900mm LP PE80
- 5000mm LP PE80
- 5100mm LP PE80
- 5200mm LP PE80
- 5300mm LP PE80
- 5400mm LP PE80
- 5500mm LP PE80
- 5600mm LP PE80
- 5700mm LP PE80
- 5800mm LP PE80
- 5900mm LP PE80
- 6000mm LP PE80
- 6100mm LP PE80
- 6200mm LP PE80
- 6300mm LP PE80
- 6400mm LP PE80
- 6500mm LP PE80
- 6600mm LP PE80
- 6700mm LP PE80
- 6800mm LP PE80
- 6900mm LP PE80
- 7000mm LP PE80
- 7100mm LP PE80
- 7200mm LP PE80
- 7300mm LP PE80
- 7400mm LP PE80
- 7500mm LP PE80
- 7600mm LP PE80
- 7700mm LP PE80
- 7800mm LP PE80
- 7900mm LP PE80
- 8000mm LP PE80
- 8100mm LP PE80
- 8200mm LP PE80
- 8300mm LP PE80
- 8400mm LP PE80
- 8500mm LP PE80
- 8600mm LP PE80
- 8700mm LP PE80
- 8800mm LP PE80
- 8900mm LP PE80
- 9000mm LP PE80
- 9100mm LP PE80
- 9200mm LP PE80
- 9300mm LP PE80
- 9400mm LP PE80
- 9500mm LP PE80
- 9600mm LP PE80
- 9700mm LP PE80
- 9800mm LP PE80
- 9900mm LP PE80
- 10000mm LP PE80

Excavation Carried Out by BUUK

Excavation shall be carried out by the contractor. The reinstatement shall be to the satisfaction of the other interested parties. It will be the responsibility of the customer.

Excavation Carried Out by BUUK

Excavation shall be carried out by the contractor. The reinstatement shall be to the satisfaction of the other interested parties. It will be the responsibility of the customer.

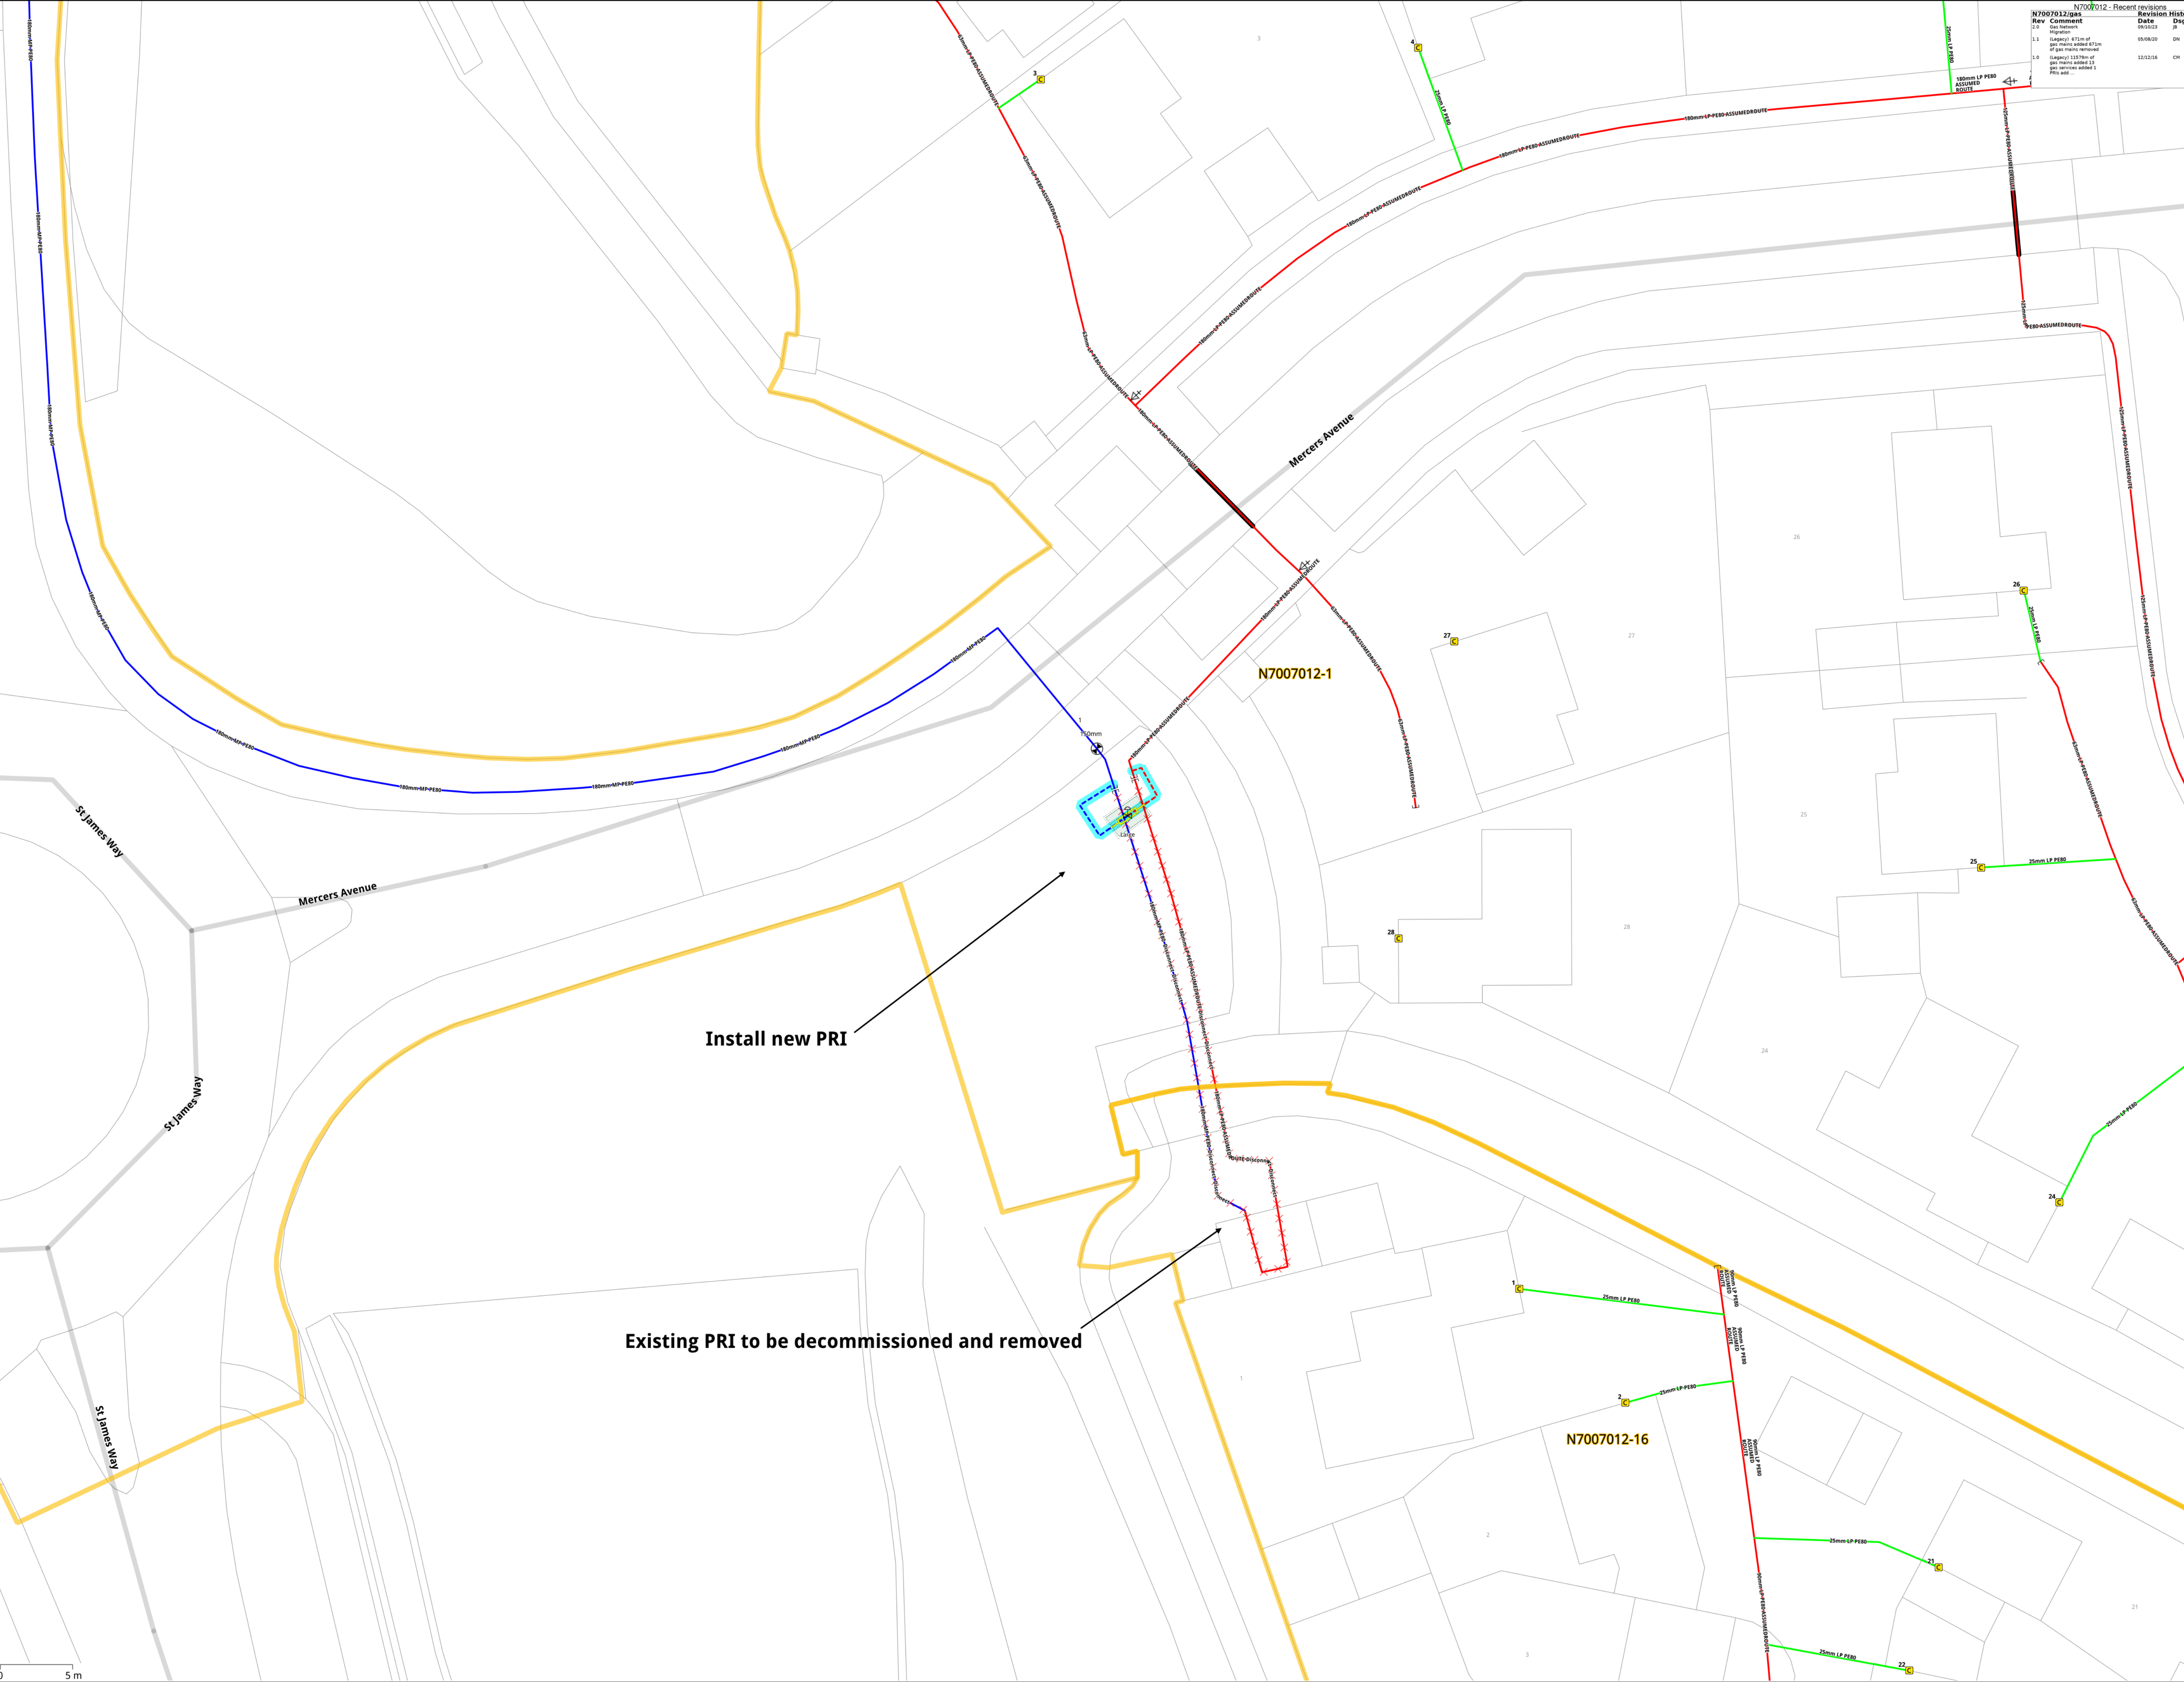

0 5m

gtec

GTC, Hivight Business Park, Lutterworth, Leics, LE15 9JF
 Tel: 01535 240393
 www.gtc-uk.co.uk

Last Edit By: [Signature]
 Last Approved By: jamiebuckle 09102023

OS Ref: 546876,219864
 Location: St Michaels Mead

Developer/Client: Countryside Properties plc
 Drawing Number/Title: 16f2ec3-0502-474b-b8b7-66af22a99a2a
 Network Number: N7007012
 Project Number: N7007012-1
 Scale: 1:200
 Sheet Size: A1
 Revision: 2.0